

DATE: _____


COMPANY: _____

JOB NAME: _____

SUBMITTED BY: _____

NOTES: _____

**DROP BOX DUCT CONCENTRIC KIT
SUBMITTAL DATA FOR:
CARRIER UNITS
48/50TJ/TM028
581A155/180 & 542J150/180 &
558/559F180-240**

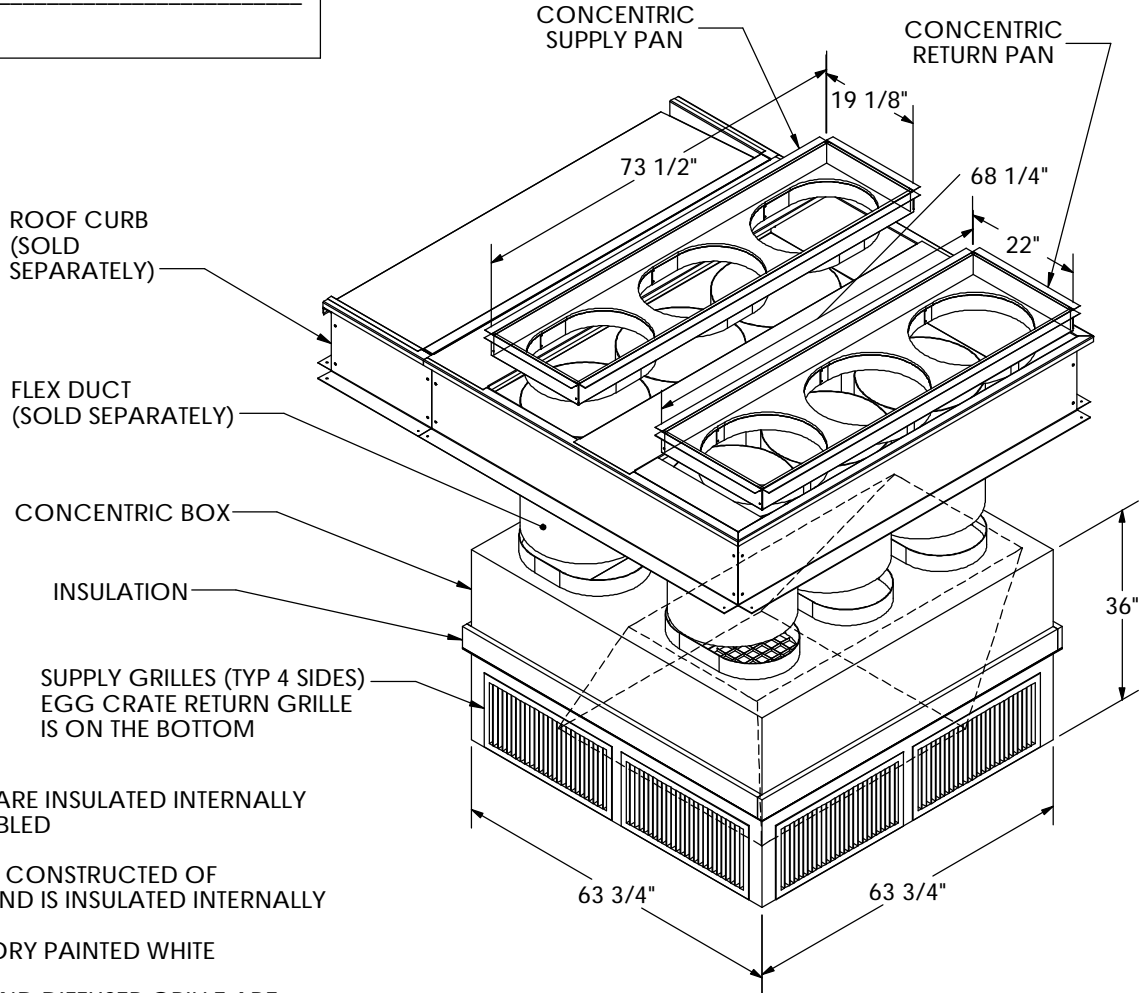

FEATURES:

- CONCENTRIC PANS ARE INSULATED INTERNALLY AND SHIPPED ASSEMBLED
- CONCENTRIC BOX IS CONSTRUCTED OF GALVANIZED STEEL AND IS INSULATED INTERNALLY
- LOWER BOX IS FACTORY PAINTED WHITE
- CONCENTRIC BOX AND DIFFUSER GRILLE ARE SHIPPED ASSEMBLED

CAMBRIDGEPORT PART NUMBER	DUCT SIZE	APPLICABLE CURB MODEL NUMBERS	FLEX (SOLD SEPARATELY)	NOMINAL CFM	THROW IN FT.	
					MIN	MAX
1012258	6 @ 20"	CRRFCURB025A00	1000090 (2-20") (3 REQ'D)	10,000	33'	63'

NOTES:

- 1 - INSTALL INSULATED ADAPTER PANS BEFORE A/C UNIT IS PLACED ON CURB.
- 2 - FIELD BAFFLES MAY BE REQUIRED FOR BALANCING
- 3 - CONCENTRIC BOX MUST BE FIELD SUPPORTED

Drawn By: CRF
Date: 06/2/08 Rev: 0

Cambridgeport
AIR SYSTEMS
MEMPHIS, TN 38118
PHONE 1-877-648-2872 FAX 901-566-0035
SALISBURY, MA 01952
PHONE 1-800-648-2872 FAX 978-462-9189